



Data Sheet
OM 402PID

Distributed by



www.bristolinstruments.com

Bristol Instruments
90 Canal Street, 4th Floor
Boston, MA 02114

Toll free
877-866-8500



UNIVERSAL PID REGULATOR

- 4-digit programmable projection
- Multifunction input (DC, PM, RTD, T/C, DU)
- 4 Outputs
- RTC with measured values record
- Digital filters, Tare, Linearization
- Size of DIN 96 x 48 mm
- Power supply 10...30 V AC/DC; 80...250 V AC/DC
- Option
Data output • Analog output

OM 402PID



OM 402PID is a 4-digit universal panel PID regulator designed for maximum flexibility and user comfort while maintaining its favourable price. It is a multifunction instrument with the option of configuration for 8 various input options, easily configurable in the instrument menu.

In its basic configuration the OM 402PID has two regulatory relays and two relay alarm outputs. Desired value can either be constant or defined by one of 14 programmes.

The instrument is based on a single-chip microcontroller and a multichannel 24-bit sigma-delta converter, which secures high accuracy, stability and easy operation of the instrument.

OM 402PID
UNIVERSAL PID REGULATOR

OPERATION

The instrument is set and controlled by five buttons located on the front panel. All programmable settings of the instrument may be performed in three adjusting modes:

LIGHT MENU is protected by optional number code and contains solely items necessary for instrument setting.

PROFI MENU is protected by optional number code and contains complete instrument setting.

USER MENU may contain arbitrary items from the programming menu (LIGHT/PROFI), which determine the right (see, change). Access w/o password.

Standard equipment is the OM Link interface, which together with operation program enables modification and filing of all instrument settings as well as performing firmware updates (with OML cable). The program is also designed for visualization and filing of measured values from more instruments.

All settings are stored in the EEPROM memory (settings hold even after the instrument is switched off).

OPTION

INPUT OF DESIRED VALUE enables the regulator to be used for follow-up control. Both current and voltage inputs can be used.

DATA OUTPUTS are for their rate and accuracy suitable for transmission of the measured data for further projection or directly into the control systems. We offer isolated RS232 and RS485 with the ASCII/PROFIBUS protocols.

STANDARD FUNCTIONS

PROGRAMMABLE PROJECTION

Selection: of input type and measuring range

Setting: manual, optional projection on the display may be set in menu for both limit values of the input signal, e.g. input 0...20 mA > 0...500.0

Projection: -999...9999

PID REGULATOR

Execution: parallel PID, PI or proportional

Relay output: double, two-state, PWM

Analog output: isolated, modes: heating, cooling, both

Required value: set, from analog output, from program

Number of programs/steps: 14/64

Launching: time - one-off/weekly, by external input, by buttons

RELAY OUTPUTS

Type: digital, adjustable in menu

Outputs: relays L1, L2 are alarm ones, relays L3, L4 are intended as regulatory but they can also be used as alarms

ANALOG OUTPUT

Usage: where this type of signal is requested by action devices, or it can be used for processing of the measured value by external devices

Type: isolated, programmable with a 12 bit D/A converter, functions, type and range of the output are selectable in the instrument's menu

COMPENSATION

Of conduct (RTD, OHM): automatic (3- or 4-wire) or manual in menu (2-wire)

Of conduct in probe (RTD): internal connection (conduct resistance in measuring head)

Of CJC (T/C): manual or automatic, in menu it is possible to perform selection of the type of thermocouple and compensation of cold junctions, which is adjustable or automatic (temperature of terminals)

DIGITAL FILTERS

Floating/Exp./Arithm. average: from 2...30/100/100 measurements

Rounding: setting the projection step for display

FUNCTIONS

Linearization: non-linear signals can be linearized by the means of a linearisat. table

Min./max. value: registration of min./max. value reached during measurement

Tare: designed to reset display upon non-zero input signal

Peak value: the display shows only max. or min. value

Mathemat. operations: polynom, root

TECHNICAL DATA

INPUT

Number of inputs			1		
DC	Range	optional in configuration menu			
		±60 mV	> 100 MΩ		
		±150 mV	> 100 MΩ		
		±300 mV	> 100 MΩ		
		±1200 mV	> 100 MΩ		
PM	Range	optional in configuration menu			
		0...20 mA	< 400 mV		
		4...20 mA	< 400 mV		
		±2 V	1 MΩ		
		±5 V	1 MΩ		
	±10 V	1 MΩ			
	±40 V	1 MΩ			
	Required value	optional extensions - by order			
		range and setting is the same as option „PM“			
		connection to inputs - Required value U/I*			
OHM		Range	optional in configuration menu with autorange		
			0...100 Ω		
	0...1 kΩ				
	0...10 kΩ				
	0...100 kΩ				
Connection	2, 3 or 4 wire				
	Pt	Type	optional in configuration menu		
EU > 100/500/1 000 Ω, 3 850 ppm/°C			-50°...450°C		
US > 100 Ω, 3 920 ppm/°C			-50°...450°C		
RU > 50 Ω, 3 910 ppm/°C			-200°...1 100°C		
RU > 100 Ω, 3 910 ppm/°C			-200°...450°C		
Connection	2, 3 or 4 wire				
	Ni	Type	optional in configuration menu		
Ni 1 000/10 000 with 5 000 ppm/°C			-50°...250°C		
Ni 1 000/10 000 with 6 180 ppm/°C			-50°...250°C		
Connection			2, 3 or 4 wire		
			Cu	Type	optional in configuration menu
Cu 50/100 with 4 260 ppm/°C	-50°...200°C				
Cu 50/100 with 4 280 ppm/°C	-200°...200°C				
Connection	2, 3 or 4 wire				
	T/C	Type			optional in configuration menu
J (Fe-CuNi)			-200°...900°C		
K (NiCr-Ni)			-200°...1300°C		
T (Cu-CuNi)			-200°...400°C		
E (NiCr-CuNi)			-200°...690°C		
B (PtRh30-PtRh6)			300°...1820°C		
S (PtRh10-Pt)			-50°...1760°C		
R (Pt13Rh-Pt)			-50°...1740°C		
N (Omegalloy)			-200°...1300°C		
L (Fe-CuNi)			-200°...900°C		
DU			Pot. power supply	2 VDC/6 mA, Potentiometer resistance > 500 Ω	

Ext. inputs

3 inputs, on contact

The following functions can be assigned:

OFF

input off

HOLD

display stop

LOCK

control keys blocking

PASS.

menu access blocking

TARE

tare activation

CL. TA

tare resetting

CL. M.M.

resetting min/max value

SAVE

data recording start (FAST/RTC)

CL. ME.

data recording reset (FAST/RTC)

STOP R.

regulation stop

STAR. P.

running regulation to the spec. value

STAR. A

running regulation to „Required value“

PROJECTION

Display: -999...9999, single color 14-segment LED

Digit height: 14 mm

Display color: red or green

Auxiliary display: 2x -999...9999, green 7seg. LED, height 9 mm

The upper display shows the number of the program/step, the lower display shows the desired value

Signalling LED: yellow (regulation) - „+“, „-“, „3“, „4“

red (alarm) - „1“, „2“, „3“, „4“, green (tare) - „T“, „I“

Decimal point: adjustable - in menu

Brightness: adjustable - in menu

INSTRUMENT ACCURACY

TC: 50 ppm/°C

Accuracy: ±0,1% of range + 1 digit (for projection 9999 and 5 measur./s)

±0,15% of range + 1 digit

Accuracy of cold junction measur.: ±1,5°C

Rate: 0,1...40 measurement/s

Overload capacity: 2x; 10x (t < 30 ms)

Resolution (RTD, T/C): 1°/0,1°/0,01°C

Line compensation: max. 30 Ω (RTD)

Cold junction compens.: adjustable -20°...99°C or automatic

Linearization: linear interpolation in 50 points (only via OM Link)

Digital filters: Exp./Floating/Arithm. average, Rounding

Functions: Offset, Min/max value, Tare, Peak value, Mat. operations

Ext. operation: HOLD, LOCK, tare, Min/Max a functions PID

Data record: measured data record into instrument memory

RTC - 15 ppm/°C, time-date-display value < 266k data

OM Link: company communication interface for operation, setting and update of instruments

Watch-dog: reset after 400 ms

Calibration: at 25°C and 40 °C r.h.

COMPARATOR

Type: digital, menu adjustable, contact switch-on < 30 ms

Hysteresis mode: switching limit, hysteresis band (Lim and ±1/2 Hys) and time (±99,9 s) determining the switching delay

Mode From-To: switching on and switching off interval

Mode double-state - L3 switches at negative deviation (INCREASE), L4 switches at positive deviation (DECREASE)

Mode PWM - L3 switches at negative deviation (INCREASE), L4 switches at positive deviation (DECREASE)

MODE PROGRAM

The relay is active after the program has ended, if the time „0“ is set - permanently, otherwise for a period of time „TIM. L.2“

Mode Ready - the relay action occurs when the setpoint is reached for the first time, the relay turns off when the setpoint is changed; the relay is activated when the setpoint is reached; if the time „0“ is set - permanently, otherwise for the period of time „TIM. L.1“

Output: 2x relays Form A (250 VAC/30 VDC, 3 A)

2x relays FORM C (250 VAC/50 VDC, 3 A);

4x open collector (30 VDC/100 mA) or 2x SSR (250 VAC/1 A)

DATA OUTPUTS

Protocol: ASCII, MESSBUS, MODBUS RTU, PROFIBUS DP

Data format: 8 bit + no parity + 1 stop bit (ASCII)

7 bit + even parity + 1 stop bit (Messbus)

Rate: 600...230 400 Baud, 9 600 Baud...12 Mbaud (PROFIBUS)

RS 232: isolated

RS 485: isolated, addressing (max. 31 instruments)

ANALOGUE OUTPUT

Type: ei isolated, programmable with a 16 bit D/A converter, functions, type and output range are selectable in the menu

Non-linearity: 0,1% of range

TC: 15 ppm/°C

Rate: response to change of value < 1 ms

Ranges: 0...2/5/10 V, ±10 V, 0...5 mA, 0/4...20 mA (comp. < 600 Ω/12 V or 1 000 Ω/24 V)

EXCITATION

Adjustable: 5...24 VDC/max. 1,2 W

POWER SUPPLY

Range: 10...30 V AC/DC, ±10 %, PF≥ 0,4, I_{trip} < 40 A/1 ms, isolated 80...250 V AC/DC, ±10 %, PF≥ 0,4, I_{trip} < 40 A/1 ms, isolated

Consumption: < 9,4 W/9,2 VA

Power supply is protected by a fuse inside the instrument.

MECHANIC PROPERTIES

Material: Noryl GFN2 SEI, incombustible UL 94 V-1

Dimensions: 96 x 48 x 120 mm (w x h x d)

Panel cutout: 90,5 x 45 mm (w x h)

OPERATING CONDITIONS

Connection: connector terminal blocks, section < 1,5/2,5 mm²

Stabilization period: within 5 minutes after switch-on

Temperature working/storing: -20°...60°C/0/-20°...80°C

Protection: IP64 (front panel only)

El. safety: EN 61010-1, A2

Dielectric strength: 4 kVAC per 1 min test between supply and input

4 kVAC per 1 min test between supply and data/analog output

4 kVAC per 1 min test between input and relay output

2,5 kVAC per 1 min test between input and data/analog output

Insulation resistance: for pollution degree II, measuring cat. III

power supply > 670 V (PI), 300 V (DI)


input, output, PN > 300 V (PI), 150 V (DI)

EMC: EN 61326-1

PI - Primary insulation, DI - Double insulation

PI = Primary insulation, DI = Double insulation

CONNECTION

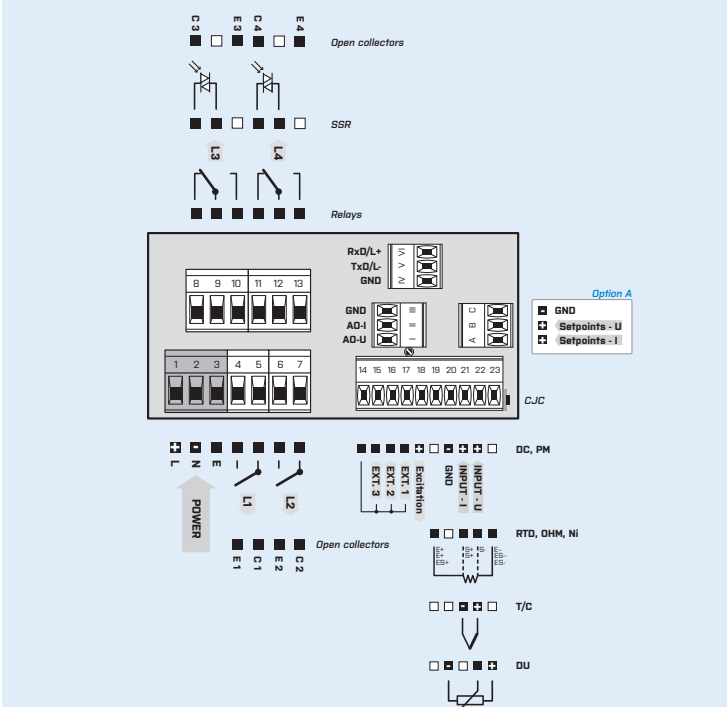

*For the „Requested value“ we recommend to connect terminals GND (main board/additional board) by external connection.

ORDER CODE

OM 402PID		-						1	-
Power supply	10...30 V AC/DC 80...250 V AC/DC	0 1							
Input for the requested value	no yes	0 A							
Alarm relays (outputs L3, L4)	relay SSR		0 1						
Analog output	no yes (compensation < 600 Ω/12 V) yes (compensation < 1000 Ω/24 V)			0 1 2					
Data output	none RS 232 RS 485 MODBUS PROFIBUS			0 1 2 3 4					
Excitation	yes							1	
Specification	customized version, do not fill in								00

Basic configuration of the instrument is indicated in bold. * Launch for sale has not been set.

* Launch for sale has not been set.